

Clamp-T, Grooved Branch Fig. 7046



The Gruvlok Clamp-T provides a quick and easy outlet at any location along the pipe. A hole drilled or cut in the pipe to receive the locating collar of the Clamp-T is all that is required. The full, smooth outlet area provides for optimum flow characteristics.

The Clamp-T housing is specially engineered to conform to the pipe O.D. and the Clamp-T gasket providing a leak-tight reliable seal in both positive pressure and vacuum conditions. The maximum working pressure for all sizes is 500 PSI (34.5 bar) when assembled on standard wall steel pipe.

The Gruvlok Clamp-T provides for a branch or cross connection in light wall or standard wall steel pipe.

Clamp-T cross connections are available in most sizes allowing greater versatility in piping design.

For Listings / Approval Details and Limitations, visit our website at www.asc-es.com or contact an ASC Engineered Solutions® Sales Representative.

Clamp-T Flow Data (Frictional Resistance)

Branch Size	Fig. 7046 Grooved Branch	
	C.V. Value	
DN/mm		
1 1/4 32		5.4
1 1/2 40		95
2 50		148
2 1/2 65		205
3 80		294
4 100		571

Material Specifications

Bolts

SAE J429, Grade 5, Zinc Electroplated
ISO 898-1, Class 8.8, Zinc Electroplated
followed by a Yellow Chromate Dip

Heavy Hex Nuts

ASTM A563, Grade A, Zinc Electroplated
ISO 898-2, Class 8.8, Zinc Electroplated
followed by a Yellow Chromate Dip

U-Bolt

Cold drawn steel and zinc plated.

Housing

Ductile Iron conforming to ASTM A536,
Grade 65-45-12

Coatings

Rust inhibiting paint
Color: Orange (standard)
Hot Dipped Zinc Galvanized (optional)

Gasket Materials

Properties as designated in accordance with
ASTM D2000

Grade "E" EPDM (Green color code)

-40°F to 230°F (Service Temperature Range)
(-40°C to 110°C)

Recommended for water service, diluted acids,
alkalies solutions, oil-free air and many other
chemical services.

NOT FOR USE IN PETROLEUM APPLICATIONS.

Grade "T" Nitrile (Orange color code)

-20°F to 180°F (Service Temperature Range)
(-29°C to 82°C)

Recommended for petroleum applications. Air with
oil vapors and vegetable and mineral oils.

NOT FOR USE IN HOT WATER OR HOT AIR.

Lubrication

Standard Gruvlok

Gruvlok Xtreme (Do Not use with Grade "L")



PROJECT INFORMATION	APPROVAL STAMP
Project:	Approved
Address:	Approved as noted
Contractor:	Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	

Clamp-T, Grooved Branch Fig. 7046

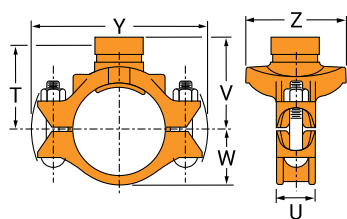


Fig. 7046

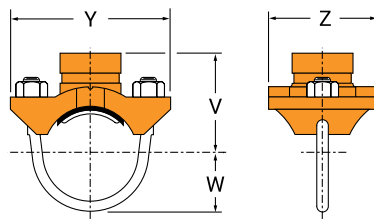


Fig. 7046 (U-Bolt)

Nominal Size	O.D.	Hole Dimensions		▼Max. Working Pressure	Frictional Resistance (Equivalent Straight Pipe)	Clamp-T Dimensions					Bolt Size	Approx. Wt. Each
		Min. Diam.	Max. Diam.			U	V Grooved	W	Y	Z		
In./DN(mm)	In./mm	In./mm	In./mm	PSI/bar	Ft	In./mm	In./mm	In./mm	In./mm	In./mm	In./mm	Lbs./kg
2½ x 1¼	2.875 x 1.660	2	2⅝	500	4.7	⅞	3⅝	1¾	6⅞	3½	½ U-Bolt	3.4
65 x 32	73.0 x 42.4	51	54	34.5		3.4	79	44	156	89	—	1.5
2½ x 1½	2.875 x 1.900	2	2⅝	500	3.4	⅞	3⅝	1¾	6⅞	3½	½ U-Bolt	3.4
65 x 40	73.0 x 48.3	51	54	34.5		7	79	44	156	89	—	1.5
3 x 1¼	3.500 x 1.660	2	2⅝	500	5.1	1½	3½	2⅝	6⅞	3¾	½ x 2¾	3.4
80 x 32	88.9 x 42.4	51	54	34.5		4.7	89	54	175	95	—	1.5
3 x 1½	3.500 x 1.900	2	2⅝	500	7	1½	3½	2⅝	6⅞	3¾	½ x 2¾	4.4
80 x 40	88.9 x 48.3	51	54	34.5		9.1	89	54	175	95	—	2.0
3 x 2	3.500 x 2.375	2½	2⅝	500	9.1	1½	3½	2⅝	6⅞	4⅞	½ x 2¾	4.6
80 x 50	88.9 x 60.3	64	67	34.5		11.3	89	54	175	105	—	2.1
4 x 1¼	4.500 x 1.660	2	2⅝	500	4.7	1⅞	4	2⅝	7½	3¾	½ x 2¾	4.2
100 x 32	114.3 x 42.4	51	54	34.5		4.7	102	67	191	95	—	1.9
4 x 1½	4.500 x 1.900	2	2⅝	500	6.9	1⅞	4	2⅝	7½	3¾	½ x 2¾	4.3
100 x 40	114.3 x 48.3	51	54	34.5		9.1	102	67	191	95	—	2.0
4 x 2	4.500 x 2.375	2½	2⅝	500	9.1	1⅞	4	2⅝	7½	4⅞	½ x 2¾	4.6
100 x 50	114.3 x 60.3	64	67	34.5		17.3	102	67	191	105	—	2.1
4 x 2½	4.500 x 2.875	2¾	2⅞	500	6.8	1⅞	4	2⅝	7½	4⅞	½ x 2¾	5.0
100 x 65	114.3 x 73.0	70	73	34.5		7	102	67	191	111	—	2.3
4 x 3 O.D.	4.500 x 2.996	2¾	2⅞	500	11.3	1⅞	4	2⅝	7½	4⅞	½ x 2¾	5.0
100 x 80	114.3 x 76.1	70	73	34.5		10.9	102	67	191	111	—	2.3
4 x 3	4.500 x 3.500	3½	3⅝	500	11.3	1⅞	4	2⅝	7½	5¼	½ x 3½	5.6
100 x 80	114.3 x 88.9	89	92	34.5		17.3	102	67	191	133	—	2.5
5 x 1¼	5.563 x 1.660	2	2⅝	500	4.7	1⅞	4¼	3¼	9⅞	3¾	⅝ x 3¼	5.6
125 x 32	141.3 x 42.4	51	54	34.5		7.3	108	83	232	95	—	2.5
5 x 1½	5.563 x 1.900	2	2⅝	500	7	1⅞	4¼	3¼	9⅞	3¾	⅝ x 3¼	5.6
125 x 40	141.3 x 48.3	51	54	34.5		7.1	108	83	232	95	—	2.5
5 x 2	5.563 x 2.375	2½	2⅝	500	9.1	1⅞	4¼	3¼	9⅞	4⅞	⅝ x 3¼	5.5
125 x 50	141.3 x 60.3	64	67	34.5		10.9	108	83	232	105	—	2.5

Note:

2½", 5" and 6" Nom. Run pipe size Clamp-T may be used on 3" O.D., 5½" O.D. and 6½" O.D. pipe.
• Cannot be used in cross configuration.

▼ Based on use with standard wall pipe.

§ – For additional Bolt Torque information, see the Technical Data Section of the Gruvlok Catalog.

See Installation & Assembly directions on last page.

Not for use with copper systems.



asc-es.com

Building connections that last™

Clamp-T, Grooved Branch Fig. 7046

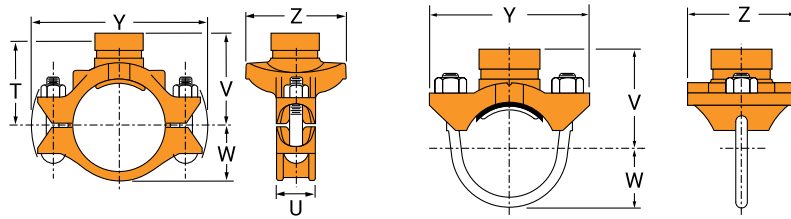


Fig. 7046

Fig. 7046 (U-Bolt)

Nominal Size	O.D.	Hole Dimensions		▼Max. Working Pressure	Frictional Resistance (Equivalent Straight Pipe)	Clamp-T Dimensions					Bolt Size	Approx. Wt. Each
		Min. Diam.	Max. Diam.			U	V Grooved	W	Y	Z		
In./DN(mm)	In./mm	In./mm	In./mm	PSI/bar	Ft	In./mm	In./mm	In./mm	In./mm	In./mm	In./mm	Lbs./kg
5 x 2½ 125 x 65	5.563 x 2.875 141.3 x 73.0	2¾ 70	2⅞ 73	500 34.5	10.9	1⅞ 17.3	4¼ 108	3¼ 83	9⅞ 232	4⅜ 111	⅝ x 3¼ —	5.8 2.6
5 x 3 125 x 80	5.563 x 3.500 141.3 x 88.9	3½ 89	3⅞ 92	500 34.5	17.3	1⅞ 7	4⅞ 117	3¼ 83	9⅞ 232	5¼ 133	⅝ x 3¼ —	7.1 3.2
6 x 1¼ 150 x 32	6.625 x 1.660 168.3 x 42.4	2 51	2⅞ 54	500 34.5	3.3	2 10.9	5 127	3⅞ 98	10⅞ 257	3¾ 95	⅝ x 4¼ *	7.2 3.3
6 x 1½ 150 x 40	6.625 x 1.900 168.3 x 48.3	2 51	2⅞ 54	500 34.5	7	2 17.3	5 127	3⅞ 98	10⅞ 257	3¾ 95	⅝ x 4¼ *	7.2 3.3
6 x 2 150 x 50	6.625 x 2.375 168.3 x 60.3	2½ 64	2⅞ 67	500 34.5	8.1	2 7.3	5 127	3⅞ 98	10⅞ 257	4⅞ 105	⅝ x 4¼ *	7.8 3.5
6 x 2½ 150 x 65	6.625 x 2.875 168.3 x 73.0	2¾ 70	2⅞ 73	500 34.5	10.9	2 7.1	5⅞ 130	3⅞ 98	10⅞ 257	4⅜ 111	⅝ x 4¼ *	7.6 3.4
6 x 3 O.D. 150 x 80	6.625 x 2.996 168.3 x 76.1	2¾ 70	2⅞ 73	500 34.5	17.3	2 51	5⅞ 130	3⅞ 98	10⅞ 257	4⅜ 111	⅝ x 4¼ *	7.6 3.4
6 x 3 150 x 80	6.625 x 3.500 168.3 x 88.9	3½ 89	3⅞ 92	500 34.5	17.3	2 12.2	5⅞ 130	3⅞ 98	10⅞ 257	5¼ 133	⅝ x 4¼ *	8.0 3.6
6 x 4 150 x 100	6.625 x 4.500 168.3 x 114.3	4½ 114	4⅞ 117	500 34.5	12.2	2 8.7	5¼ 133	3⅞ 98	10⅞ 257	6½ 165	⅝ x 4¼ *	10.4 4.7
8 x 2 200 x 50	8.625 x 2.375 219.1 x 60.3	2½ 64	2⅞ 67	500 34.5	7.3	2¼ 15.4	6⅞ 156	5 127	12¾ 324	4¼ 108	¾ x 4½ —	10.4 4.7
8 x 2½ 200 x 65	8.625 x 2.875 219.1 x 73.0	2¾ 70	2⅞ 73	500 34.5	8.7	2¼ 8.7	6⅞ 156	5 127	12¾ 324	4⅜ 111	¾ x 4½ M20 x 110	10.6 4.8
8 x 3 200 x 80	8.625 x 3.500 219.1 x 88.9	3½ 89	3⅞ 92	500 34.5	7.1	2¼ 15.4	6⅞ 156	5 127	12¾ 324	5¼ 133	¾ x 4½ M20 x 110	11.5 5.2
8 x 4 200 x 100	8.625 x 4.500 219.1 x 114.3	4½ 114	4⅞ 117	500 34.5	15.4	2¼ 57	6¼ 159	5 127	12¾ 324	6½ 165	¾ x 4½ M20 x 110	16.2 7.3

Note:

2½", 5" and 6" Nom. Run pipe size Clamp-T may be used on 3" O.D., 5½" O.D. and 6½" O.D. pipe. (Additional larger sizes on next page.)

• Cannot be used in cross configuration.

▼ Based on use with standard wall pipe.

§ – For additional Bolt Torque information, see the Technical Data Section of the Gruvlok Catalog.

See Installation & Assembly directions on last page.

Not for use with copper systems.



asc-es.com

Building connections that last™

Fig. 7045 & Fig. 7046 Clamp-T Branch Outlets

1 Pipe Preparation

Cut the appropriate size hole in the pipe and remove any burrs. Be sure to remove any debris from inside the pipe. Clean the gasket sealing surface within $\frac{5}{8}$ " of the hole and visually inspect the sealing surface for defects that may prevent proper sealing of the gasket.

Branch Size	Hole Saw Size
In.	In./(+ $\frac{1}{8}$, -0)
$\frac{1}{2}$, $\frac{3}{4}$, 1	1 $\frac{1}{2}$
1 $\frac{1}{4}$, 1 $\frac{1}{2}$	2
2	2 $\frac{1}{2}$
2 $\frac{1}{2}$	2 $\frac{3}{4}$
3	3 $\frac{1}{2}$
4	4 $\frac{1}{2}$



2 Check & Lubricate Gasket

Check the gasket to be sure it is compatible for the intended service. Apply a thin layer of Gruvlok® lubricant to the back surface of the gasket. Be careful that foreign particles do not adhere to the lubricated surfaces. Insert the gasket back into the outlet housing making sure the tabs in the gasket line up with the tab recesses in the housing.

3 Gasket Installation

Lubricate the exposed surface of the gasket. Align the outlet housing over the pipe hole making sure that the locating collar is in the pipe hole.

4 Alignment

Align the strap around the pipe, insert the bolts and tighten the nuts finger tight. Some sizes use a U-bolt design.

5 Tighten Nuts

Alternately and evenly tighten the nuts to the specified bolt torque.

6 Assembly Complete

ALWAYS USE A GRUVLOK LUBRICANT FOR PROPER COUPLING ASSEMBLY.

Thorough lubrication of the gasket is essential to assist the gasket into the proper sealing position.

Figs. 7045 & 7046 Specified Bolt Torque

Specified bolt torque is for the oval neck track bolts and U-bolts used on the Gruvlok Clamp-T's. The nuts must be tightened alternately and evenly until fully tightened. Caution: Use of an impact wrench is not recommended because the torque output can vary significantly due to many variables including air pressure, battery strength and operational variations.

CAUTION: Proper torquing of the bolts or U-bolts is required to obtain the specified performance. Overtorquing the bolts or U-bolts may result in damage to the bolt, U-bolt and/or casting which could result in lower pressure retention capabilities, lower bend load capabilities, pipe joint leakage and pipe joint separation.

ANSI Specified Bolt Torque

Bolt Size	Wrench Size	Specified Bolt Torque*
In.	In.	Ft.-Lbs
U-Bolt	$\frac{7}{8}$	30-40
$\frac{1}{2}$	$\frac{7}{8}$	60-80
$\frac{5}{8}$	1 $\frac{1}{16}$	100-130
$\frac{3}{4}$	1 $\frac{1}{4}$	130-180

* Non-lubricated bolt torques



asc-es.com

Building connections that last™